# Bricklaying Sand - Typical Analysis

Recovered legacy reference document repackaged for the rebuilt Sand Producers WA public site.

## Material Test Report

Report No: MAT:Bricklaying Sand


### Sample Details

| | | | |
|---|---|---|---|
| **Client** | **Miscellaneous** | **Project** | **Miscellaneous** |
| **Sample ID** | Bricklaying Sand | **Field Sample** | BS11001 |
| **Date Sampled** | 29/09/2011 | **Source** | Stockpile |
| **Material** | Bricklaying Sand | **Specification** | Bricklaying |
| **Sampling Method** | Hand Sampling [AS1141.3.1] | **Location** | |

### Other Test Results

| Description | Method | Result | Limits |
|---|---|---|---|
| Clay and Fine Silt (%) | AS 1141.33 | 22 | 15 - 35 |
| Moisture Content (%) | AS 1289.2.1.1 | 4.0 | |

### Particle Size Distribution

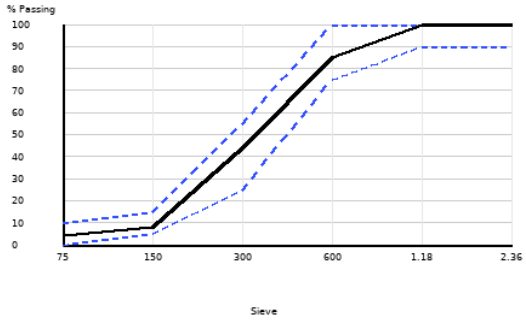


**Method:** AS 1141.11.1

**Drying by:** Hotplate

**Note:** Sample Washed

| Sieve Size | % Passing | Limits |
|---|---|---|
| 75µm | 4 | 0 - 10 |
| 150µm | 8 | 5 - 15 |
| 300µm | 44 | 25 - 55 |
| 600µm | 85 | 75 - 100 |
| 1.18mm | 100 | 90 - 100 |
| 2.36mm | 100 | 90 - 100 |

**Comments:** N/A

THIS DOCUMENT SHALL NOT BE REPRODUCED EXCEPT IN FULL